



BSI Standards Publication

<http://www.china-gauges.com/>

Grouts for ceramic tiles

Part 2: Test methods

National foreword

This British Standard is the UK implementation of [EN 13888-2:2022](#). It supersedes [BS EN 12808-5:2008](#), [BS EN 12808-1:2008](#), [BS EN 12808-2:2008](#), [BS EN 12808-3:2008](#) and [BS EN 12808-4:2009](#), which are withdrawn.

The UK participation in its preparation was entrusted to Technical Committee B/539, Ceramic tiles and other rigid tiling.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

© The British Standards Institution 2022
Published by BSI Standards Limited 2022

ISBN 978 0 539 06264 9

ICS 91.100.10

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 September 2022.

Amendments/corrigenda issued since publication

| Date | Text affected |
|------|---------------|
|------|---------------|

EUROPEAN STANDARD

EN 13888-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

September 2022

ICS 91.100.10

Supersedes EN 12808-1:2008, EN 12808-2:2008,

English Version

Grouts for ceramic tiles - Part 2: Test methods

Mortiers de jointolement pour carreaux et dalles
céramiques - Partie 2 : Méthodes d'essai

Fugenmörtel für keramische Fliesen
und Platten - Teil 2: Prüfverfahren

This European Standard was approved by CEN on 8 August 2022.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents

Page

| | |
|--|-----|
| European foreword | iii |
| 1 Scope | 4 |
| 2 Normative references | 4 |
| 3 Terms and definitions | 4 |
| 4 Sampling | 4 |
| 5 Test conditions | 5 |
| 6 Test materials | 5 |
| 7 Mixing of grouts | 5 |
| 8 Test report | 5 |
| 9 Test methods | 6 |
| 9.1 Determination of flexural and compressive strength | 6 |
| 9.1.1 Apparatus | 6 |
| 9.1.2 Preparation of test specimens | 6 |
| 9.1.3 Flexural strength under standard conditions | 7 |
| 9.1.4 Compressive strength under standard conditions | 7 |
| 9.1.5 Flexural and compressive strength after freeze-thaw cycles | 7 |
| 9.1.6 Evaluation of results | 7 |
| 9.1.7 Test report | 8 |
| 9.2 Determination of water absorption | 9 |
| 9.2.1 Apparatus | 9 |
| 9.2.2 Preparation of test specimens | 10 |
| 9.2.3 Test procedure | 10 |
| 9.2.4 Evaluation and expression of results | 10 |
| 9.2.5 Test report | 11 |
| 9.3 Determination of shrinkage | 11 |
| 9.3.1 Apparatus | 11 |
| 9.3.2 Preparation of test specimens | 12 |
| 9.3.3 Test procedure | 12 |
| 9.3.4 Evaluation of results | 12 |
| 9.3.5 Test report | 12 |
| 9.4 Determination of resistance to abrasion | 16 |
| 9.4.1 Apparatus | 16 |
| 9.4.2 Preparation of test specimens | 16 |
| 9.4.3 Test procedure | 17 |
| 9.4.4 Expression of results | 17 |
| 9.4.5 Test report | 17 |
| 9.5 Determination of chemical resistance | 20 |
| 9.5.1 Apparatus | 20 |
| 9.5.2 Test specimen | 20 |
| 9.5.3 Test procedure | 21 |
| 9.5.4 Evaluation and expression of results | 22 |
| 9.5.5 Test report | 23 |
| Bibliography | 24 |

European foreword

This document ([EN 13888-2:2022](#)) has been prepared by Technical Committee CEN/TC 67 “Ceramic tiles”, the secretariat of which is held by UNI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 2023, and conflicting national standards shall be withdrawn at the latest by March 2023.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes [EN 12808-1:2008](#), [EN 12808-2:2008](#), [EN 12808-3:2008](#), [EN 12808-4:2009](#) and [EN 12808-5:2008](#).

This document belongs to series [EN 13888](#), *Grouts for ceramic tiles*, which consists of the following parts:

- *Part 1: Requirements, classification, designation, marking and labelling;*
- *Part 2: Test methods.*

Any feedback and questions on this document should be directed to the users’ national standards body. A complete listing of these bodies can be found on the CEN website.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.

1 Scope

This document specifies the methods for determining characteristics for grouts used in internal and external installation of ceramic tiles.

This document does not contain performance requirements or recommendations for the design and installation of ceramic tiles.

The following test methods are described:

- Determination of flexural and compressive strength (9.1);
- Determination of water absorption (9.2);
- Determination of shrinkage (9.3);
- Determination of resistance to abrasion (9.4);
- Determination of chemical resistance (9.5).

Grouts for ceramic tiles can also be used for other kinds of tiles (natural and agglomerated stones, etc.), if they do not adversely affect the stones.

WARNING — — This document can involve hazardous materials and operations. It is important that persons using this document are familiar with normal laboratory practice. This document does not purport to address all the safety problems, if any, associated with its use. It is the responsibility of the user to establish appropriate safety and health practices and to ensure compliance with any European and national regulatory conditions.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

[EN 196-1:2016](#), *Methods of testing cement - Part 1: Determination of strength*

[EN 1067](#), *Adhesives - Examination and preparation of samples for testing*

EN ISO 10545-6, *Ceramic tiles - Part 6: Determination of resistance to deep abrasion for unglazed tiles (ISO 10545-6)*

[EN ISO 15605](#), *Adhesives - Sampling (ISO 15605)*

3 Terms and definitions

No terms and definitions are listed in this document.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

4 Sampling

Take at least 2 kg sample of the grout in accordance with [EN ISO 15605](#) and [EN 1067](#).

5 Test conditions

Standard conditions shall be $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \%$ relative humidity and the speed of air in the testing area less than 0,2 m/s.

The tolerance in the time of conditioning for all test specimens shall be as shown in [Table 1](#) below:

Table 1 — Allowed tolerance in testing time for all specimens requiring conditioning

| Specimen conditioning time | Allowed tolerance for testing |
|----------------------------|-------------------------------|
| 6 h | ± 15 min |
| 7 d | ± 3 h |
| 14 d | ± 6 h |
| 21 d | ± 9 h |
| 28 d | ± 12 h |

Testing shall be performed within the specified time window.

6 Test materials

Condition all test materials for at least 24 h under standard conditions.

The grout to be tested shall be within its shelf life, where this is specified.

7 Mixing of grouts

The amount of water and/or liquid admix required for preparing the cementitious grout shall be as stated by the manufacturer in parts by weight, i.e. liquid to dry powder.

Prepare at least 2 kg of the grout in a mixer of the type described in [EN 196-1:2016](#), 4.4, using the slow speed settings, (140 ± 5) r/min rotation and (62 ± 5) r/min planetary movement.

Carry out the following procedure:

- pour the liquid into the pan;
- scatter the dry powder over the liquid;
- mix for 30 s;
- take out the mixing paddle;
- scrape down the paddle and pan within 1 min;
- put the paddle back in place and mix for 1 min.

Let the grout mature if and as specified in the manufacturer's instructions, and then mix for a further 15 s.

In the case of reaction resin grouts, follow the manufacturer's instructions.

8 Test report

The test report shall provide the following information:

- a) number, title and issue of this document;
- b) place and date of sampling;

- c) type of grout, commercial designation and manufacturer name;
- d) identification of the test sample;
- e) handling and storage of samples before testing;
- f) test conditions;
- g) date of testing;
- h) amount of water or liquid used for preparing the grout;
- i) result of the visual inspection of the specimen before testing;
- j) any other factor that could have influenced the result;
- k) test results (individual and mean values and mode of failure where required):
 - 1) flexural and compressive strength;
 - 2) water absorption;
 - 3) shrinkage
 - 4) resistance to abrasion;
 - 5) chemical resistance.

9 Test methods

9.1 Determination of flexural and compressive strength

9.1.1 Apparatus

9.1.1.1 Three gang mould shall consist of three horizontal compartments so that three prismatic specimens 40 mm x 40 mm x 160 mm can be prepared simultaneously (see [EN 196-1:2016](#), 4.5).

9.1.1.2 Jolting apparatus or jolting table used for the compaction of 40 mm x 40 mm x 160 mm grout specimen, which shall comply with [EN 196-1:2016](#), 4.6.

9.1.1.3 Flexural strength testing machine shall be capable of applying the load with suitable capacity and sensitivity for the test. The machine shall be provided with a flexure device in accordance with [EN 196-1:2016](#), 4.7 (see [Figure 1](#)).

9.1.1.4 Compressive strength testing machine shall comply with [EN 196-1:2016](#), 4.8. The test requires the use of a jig (in accordance with [EN 196-1:2016](#), 4.9) to be incorporated in the lower platen; the upper platen receives the load from the machine through an intermediate spherical seating (see [Figure 2](#)).

9.1.2 Preparation of test specimens

Mould the specimens immediately after the preparation of the grout, with the mould firmly clamped to the jolting table.

Introduce, using a suitable scoop, the first of two layers of grout into each of the compartments, directly from the mixing bowl. Spread the layer uniformly, then compact using 60 jolts.

Introduce the second layer of grout, level and compact with a further 60 jolts.

Lift the mould gently from the jolting table, strike off excess of material and smooth the surface with a flat trowel. Wipe off the grout left on the perimeter of the mould.

Cover the mould with a glass plate according to [EN 196-1](#).

Place the mould, suitably identified, on a horizontal base in standard conditions, $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \% \text{R.H.}$

After 24 h carefully remove the specimen from the mould.

Keep the demoulded prism in standard conditions for 27 d leaving a clearance of at least 25 mm on all sides.

Prepare three specimens for each grout.

9.1.3 Flexural strength under standard conditions

After conditioning has been completed, place the prism in the testing machine ([9.1.1.3](#)) with one side face on the supporting rollers and with the longitudinal axis normal to the support.

Apply the load vertically in accordance with the procedure described in [EN 196-1:2016](#), 9.1.

Keep the prism halves in standard conditions until tested in compression.

9.1.4 Compressive strength under standard conditions

Test the prism halves broken in flexion, by means of the equipment specified in [9.1.1.4](#) and following the procedure described in [EN 196-1:2016](#), 9.2.

9.1.5 Flexural and compressive strength after freeze-thaw cycles

Prepare the test units in accordance with [9.1.2](#).

Condition the test units for 6 d in standard conditions and then immerse in water for 21 d before carrying out 25 freeze-thaw cycles, in accordance with the following procedure.

For each freeze-thaw cycle:

- remove the test units from the water and lower the temperature to $(-15 \pm 3) ^\circ\text{C}$ within $2 \text{ h} \pm 20 \text{ min}$;
- maintain the test units at $(-15 \pm 3) ^\circ\text{C}$ for $2 \text{ h} \pm 20 \text{ min}$;
- immerse the test units in water at $(20 \pm 3) ^\circ\text{C}$ and raise the temperature of water to $(15 \pm 3) ^\circ\text{C}$ for at least $2 \text{ h} \pm 20 \text{ min}$.

Repeat the cycle 25 times.

Condition the test units for 3 d in standard conditions after the last cycle and prior to test examine them and record a brief description of surface appearance of the specimen. Determine the flexural strength in accordance with [9.1.3](#) and the compressive strength in accordance with [9.1.4](#).

9.1.6 Evaluation of results

9.1.6.1 Flexural strength

The flexural strength (R_f) is calculated from:

$$R_f = \frac{1,5 F_f L}{b^3} \text{ N / mm}^2$$

(1)

where

- b is the length of the side of the square section of the prism, in millimetres;
- F_f is the load applied to the middle of the prism at fracture, in newtons;
- L is the distance between the supports, in millimetres.

Calculate the mean of the three determinations to the nearest 0,1 N / mm².

9.1.6.2 Compressive strength

The compressive strength (R_c) is calculated from:

$$R_c = \frac{F_c}{1\,600} \text{ N / mm}^2$$

(2)

where

- F_c is the maximum load at fracture, in newtons;
- 1 600 = 40 mm x 40 mm is the area of the platens or auxiliary plates, in square millimetres.

Calculate the mean of the six results obtained from the test to the nearest 0,1 N / mm².

9.1.7 Test report

The information listed in [Clause 8](#), items a) to j) shall be provided plus item k) 1: flexural and compressive strength.


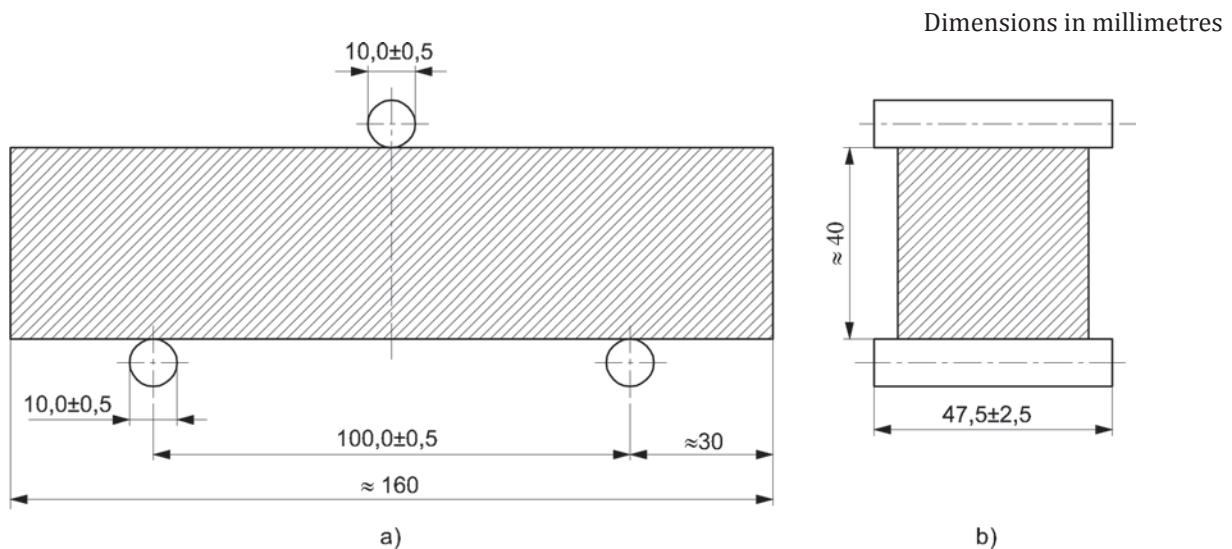


Figure 1 — Arrangement of loading for determination of flexural strength

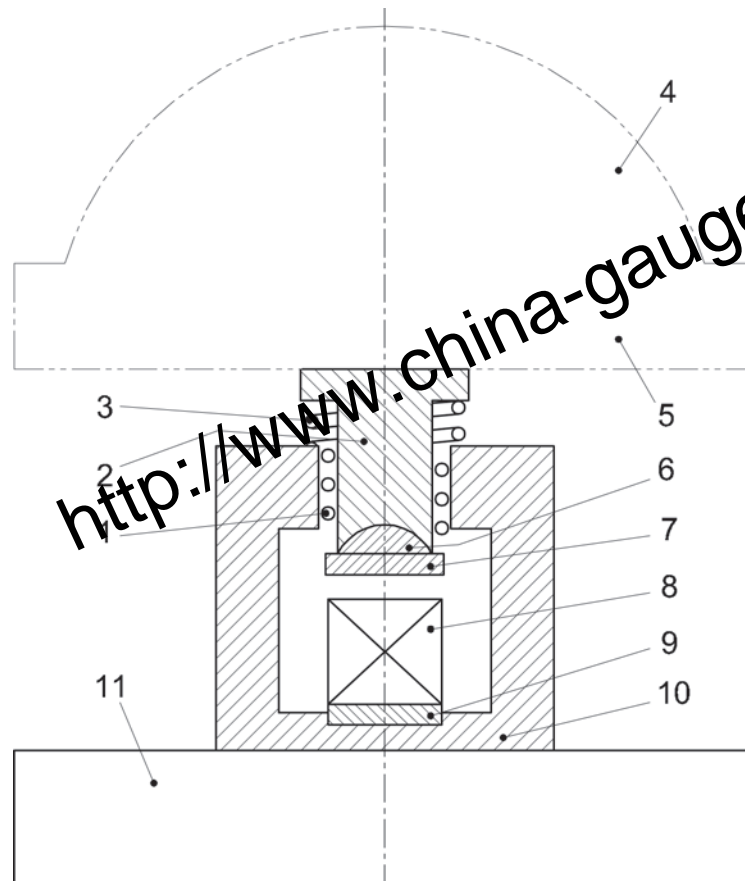

Key

- 1 ball bearings
- 2 sliding assembly
- 3 return spring
- 4 spherical seating of machine
- 5 upper platen of machine
- 6 spherical seating of the jig
- 7 upper platen of the jig
- 8 specimen
- 9 lower plate
- 10 lower platen of the jig
- 11 lower platen of the machine

Figure 2 — Typical jig for compressive strength testing

9.2 Determination of water absorption

9.2.1 Apparatus

9.2.1.1 Three gang mould with ground surfaces, made of steel, used for the preparation of 40 mm x 40 mm x 160 mm prisms, in accordance with [EN 196-1:2016](#), 4.5.

9.2.1.2 Jolting apparatus or jolting table used for the compaction of 40 mm x 40 mm x 160 mm grout specimen, in accordance with [EN 196-1:2016](#), 4.6.

9.2.1.3 Tray with a flat base, large enough to contain three test specimens.

9.2.2 Preparation of test specimens

Insert a 1 mm thick, rigid, plastic (e.g. PTFE) or metal divider into each compartment of the mould, approximately in the middle, parallel to the ends.

Mould the specimens immediately after the preparation of the grout, with the mould firmly clamped to the jolting table.

Introduce, using a suitable scoop, the first of two layers of grout into each of the compartments, directly from the mixing bowl. Spread the layer uniformly, then compact using 60 jolts.

Introduce the second layer of grout, level and compact with a further 60 jolts.

Lift the mould gently from the jolting table, strike off excess of material and smooth the surface with a flat trowel. Wipe off the grout from the perimeter of the mould. Cover the mould with a glass plate according to [EN 196-1](#).

Place the mould, suitably identified, on a horizontal base in standard conditions, $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \% \text{R.H.}$

After 24 h, carefully remove the specimen from the mould.

Keep the demoulded prisms for 27 d in standard conditions, leaving a clearance of at least 25 mm on all sides.

Prepare six specimens for each grout.

9.2.3 Test procedure

After 21 d from specimen preparation, seal the side faces by means of a neutral curing silicone sealant so as to be water impermeable.

After 28 d from specimen preparation, weigh, with 0,1 g precision, each test sample and then place them in the tray with the upper surface down, immersed in water 5 mm to 10 mm deep, taking care to prevent the prism faces from coming in contact with each other.

Maintain the water level constantly by adding water when necessary.

After 30 min, remove the test samples from water, quickly dry them by blotting with a dampened cloth and immediately weigh. Replace in the tray and repeat the procedure after 210 min.

9.2.4 Evaluation and expression of results

Calculate the water absorption, in grams, after 30 min and 240 min of each sample using the following formula:

$$\frac{W_{mt}}{m_d} = \frac{m_t - m_d}{m_d} \quad (3)$$

where

W_{mt} is the water absorption, in grams;
 m_d is the mass of the dry specimen, in grams;
 m_t is the mass of the specimen after immersion, in grams.

Determine the mean of the six values.

Discard the values falling outside the range of $\pm 20\%$ from the mean value.

If three or more than three values remain, determine the new mean value.

If less than three values remain, repeat the test.

9.2.5 Test report

The information listed in [Clause 8](#), items a) to j) shall be provided plus item k) 2: water absorption.

9.3 Determination of shrinkage

9.3.1 Apparatus

9.3.1.1 Moulds, used to prepare prismatic specimens 40 mm x 40 mm x 160 mm (three-gang mould), with ground surfaces, made of steel, in accordance with [EN 196-1](#). Holes for fitting suitable pins shall be drilled into the ends of the sides of the moulds corresponding to the ends of test specimen (see [Figure 3](#)).

Moulds provided with internal dimensions (10 \pm 0,5) mm width, (40 \pm 0,5) mm depth and (160 \pm 1) mm length, to enable three specimens to be prepared simultaneously; either:

- 1) moulds with horizontal compartments 10 mm x 40 mm x 160 mm (see [EN 196-1](#) in principle); or
- 2) moulds in accordance with [EN 196-1](#) with horizontal compartments 40 mm x 40 mm x 160 mm and width reducing plastic or metal inserts ([9.2.2](#)), two for each mould.

9.3.1.2 Six smooth, rigid, non-absorbent frames (e.g. in polyethylene or PTFE) to be inserted, with dimensions of 40 mm x 160 mm and thickness of 15 mm.

9.3.1.3 Jolting apparatus or jolting table used for the compaction of 10 mm x 40 mm x 160 mm grout specimen; in accordance with [EN 196-1](#).

9.3.1.4 Measuring apparatus that shall consist of a measurement attachment and a base with adjustment screws. The measurement attachment shall be formed either by an analogue or digital gauge, which reads accurately to 0,01 mm, rigidly mounted in a measuring frame (see [Figures 4, 5 and 6](#)).

9.3.1.5 Calibration rod or reference rod that shall be used as a standard length against which gauge readings can be tested. The rod shall be made of material having a negligible coefficient of expansion (e.g. Invar).

9.3.2 Preparation of test specimens

Insert two non-absorbent frames at the sides of each compartment of the mould, to reduce the width to 10 mm when using a 40 mm wide mould according to item 2 of 9.3.1.1 (see Figure 3). Apply a thin layer of release agent to the internal faces of the mould.

Mould the specimens immediately after the preparation of the grout, with the mould firmly clamped to the jolting table.

Introduce, using a suitable scoop, the first of two layers of grout into each of the compartments, directly from the mixing bowl. Spread the layer uniformly, then compact using 60 jolts.

Introduce the second layer of grout, level and compact with a further 60 jolts.

Lift the mould gently from the jolting table, strike off excess of material and smooth the surface with a flat trowel.

Wipe off the grout left on the perimeter of the mould. Cover with a glass plate according to EN 196-1.

Place the mould, suitably identified, on a horizontal base in standard conditions, (23 ± 2) °C and (50 ± 5) % R.H.

After 24 h remove carefully the specimen from the mould and determine with the measuring apparatus (9.3.1.4) the length of the specimen (initial reading).

Keep the demoulded prism in standard conditions leaving a clearance of at least 25 mm on all sides.

Prepare three specimens for each grout.

9.3.3 Test procedure

Take the reading of each specimen $27 \text{ d} \pm 12 \text{ h}$ after the initial reading.

9.3.4 Evaluation of results

The linear shrinkage is evaluated in mm/m as the mean of three values based on the initial measurement.

9.3.5 Test report

The information listed in Clause 8, items a) to j) shall be provided plus item k) 3: shrinkage.

Dimensions in millimetres


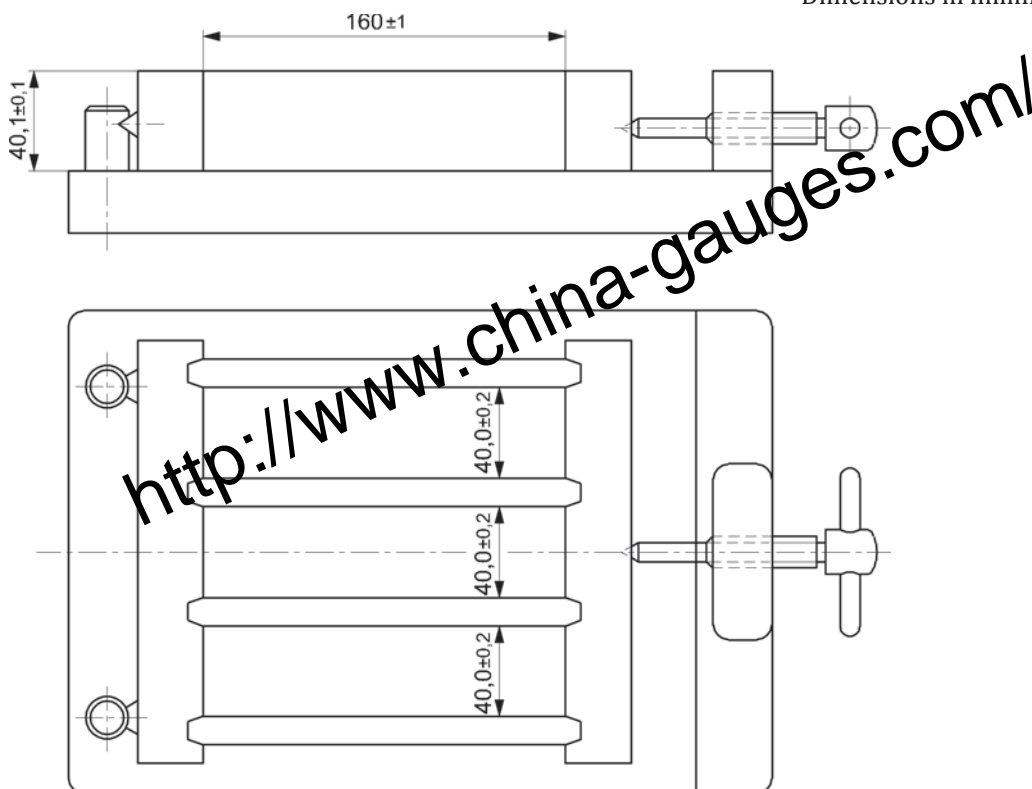



Figure 3 — Typical mould

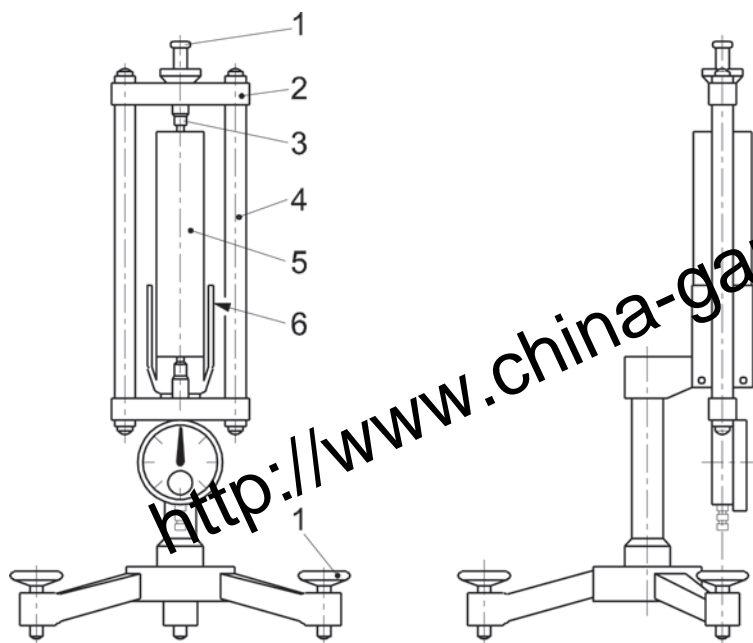

Key

- 1 adjustment screw
- 2 frame
- 3 measurement stud
- 4 side rod
- 5 specimen
- 6 holder


Figure 4 — Measuring apparatus (type A)

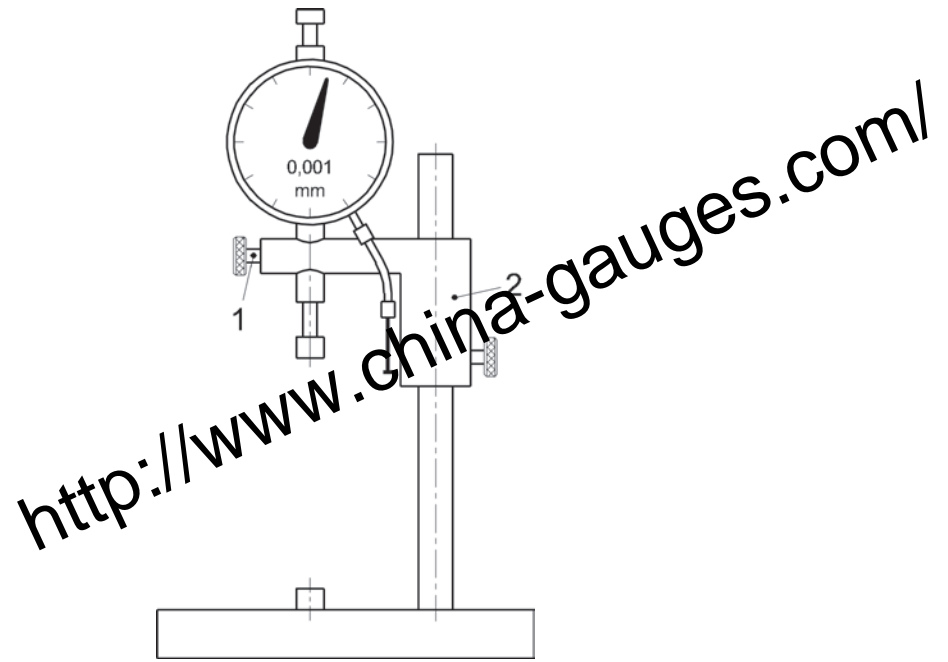

Key

- 1 stop device
- 2 holder

Figure 5 — Measuring apparatus (type B)

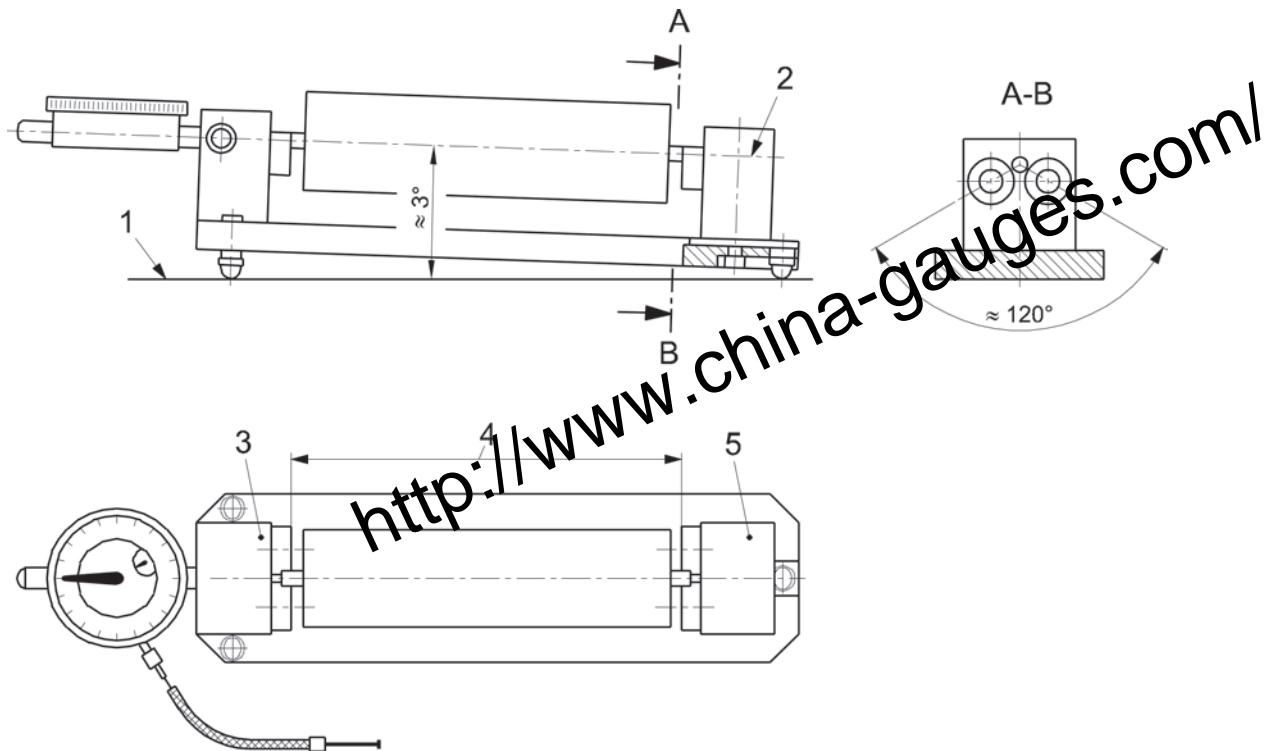

Key

- 1 horizontal
- 2 measuring axis
- 3 stand 1
- 4 measuring area (164 to 170) mm
- 5 stand 2

Figure 6 — Measuring apparatus (type C)

9.4 Determination of resistance to abrasion

9.4.1 Apparatus

9.4.1.1 Abrasion apparatus consisting essentially of a rotating disk, a storage hopper, a test specimen support and a counterweight in accordance with EN ISO 10545-6 (see [Figure 7](#)).

9.4.1.2 Abrasive material white fused aluminium oxide of grain size 80 (see EN ISO 10545-6).

9.4.1.3 Measuring gauge capable of measuring to 0,1 mm (see EN ISO 10545-6).

9.4.1.4 Template: a smooth, square, rigid, non-absorbent frame (e.g. in polyethylene or PTFE), with internal dimensions of (100 ± 1) mm x (100 ± 1) mm and thickness of (10 ± 1) mm.

9.4.2 Preparation of test specimens

Place the template over a polyethylene film.

Trowel a sufficient quantity of grout across the template and then screed clean so as to fill neatly and completely the hole in the template. Cover with a glass plate according to [EN 196-1](#). After 24 h, remove the template carefully.

Condition the units according to the test requirements.

Prepare two specimens for each grout sample.

Condition the test units for 27 d in standard conditions: (23 ± 2) °C and (50 ± 5) % R.H.

9.4.3 Test procedure

Place a test specimen in the apparatus, with the trowelled face against the wheel, so that it is tangential against the rotating disc. Ensure that the feed of abrasive material into the grinding zone is uniform at a rate of (200 ± 10) g per 100 revolutions.

Rotate the steel disc for 50 revolutions.

Remove the specimen from the apparatus and measure the chord length of the groove by means of the measuring gauge to the nearest 0.5 mm.

Test each sample in at least two places on its trowelled surface.

9.4.4 Expression of results

The resistance to abrasion is expressed as the volume V of material removed, in cubic millimetres.

This is calculated from the chord length of the groove by means of the expression:

$$V = \left(\frac{\pi\alpha}{180} - \sin\alpha \right) \cdot \frac{h \cdot d^2}{8} \quad (4)$$

where

\sin $(\alpha/2) = L/d$;

d is the diameter of the rotating disc, in millimetres;

h is the thickness of the rotating disc, in millimetres;


α is the angle (in degrees) subtended at the centre of the rotating disc by the chord (see [Figure 8](#));

L is the length of the chord, in millimetres.

Some equivalent values are given in [Table 2](#).

9.4.5 Test report

The information listed in [Clause 8](#), items a) to j) shall be provided plus item k) 4: resistance to abrasion.

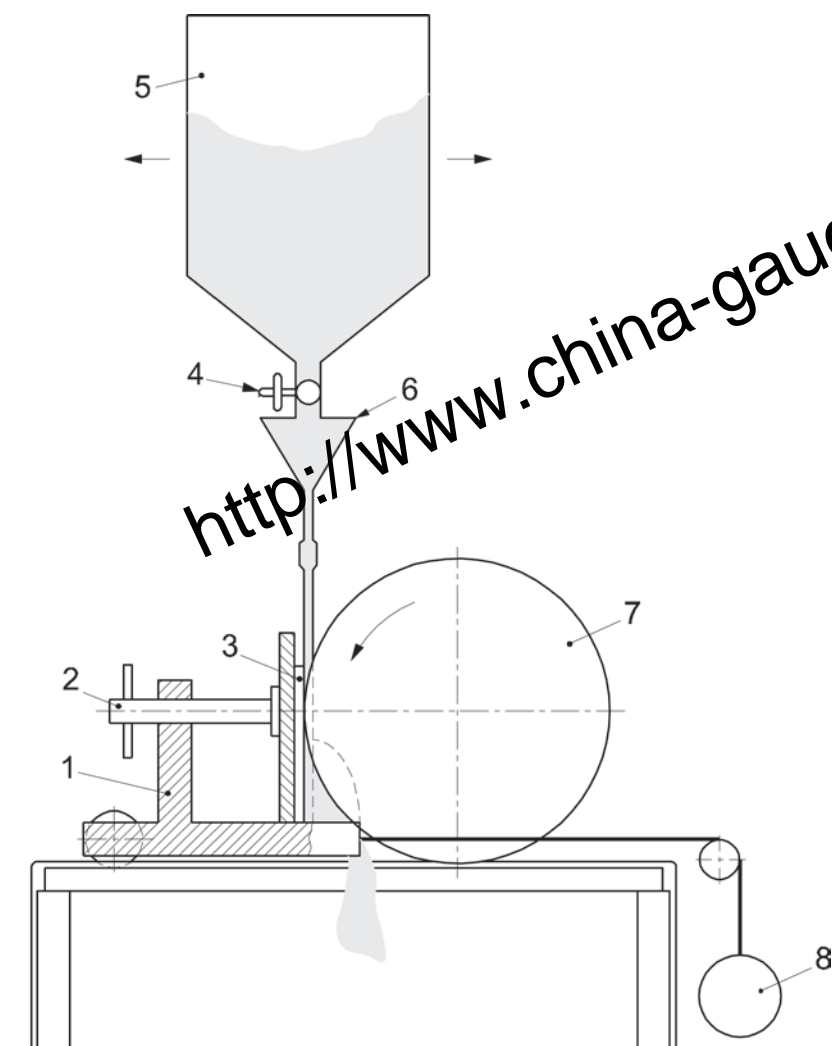

Key

- 1 test specimen clamp
- 2 fixing screw
- 3 test specimen
- 4 valve
- 5 storage hopper for abrasive material
- 6 even-flow tunnel
- 7 steel disc
- 8 counterweight

Figure 7 — Abrasion apparatus

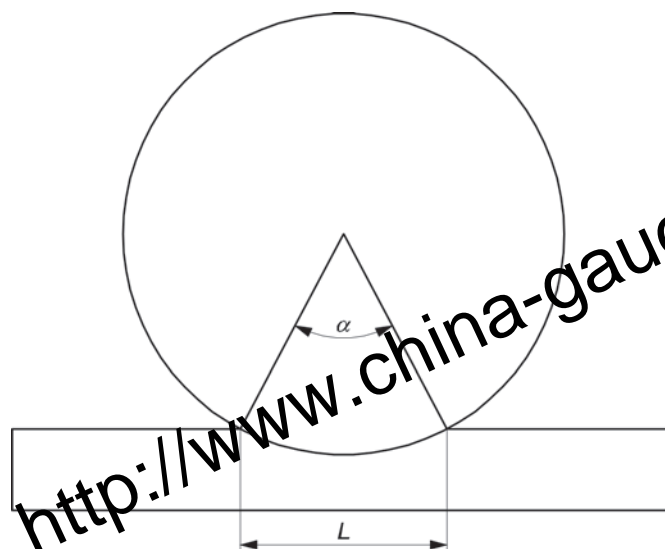


Figure 8 — Definition of chord

Table 2 — Equivalent values

| L mm | V mm ³ | L mm | V mm ³ | L mm | V mm ³ | L mm | V mm ³ | L mm | V mm ³ |
|---------|----------------------|---------|----------------------|---------|----------------------|---------|----------------------|---------|----------------------|
| 20,0 | 67 | 30,0 | 227 | 40,0 | 540 | 50,0 | 1 062 | 60,0 | 1 851 |
| 20,5 | 72 | 30,5 | 238 | 40,5 | 561 | 50,5 | 1 094 | 60,5 | 1 899 |
| 21,0 | 77 | 31,0 | 250 | 41,0 | 582 | 51,0 | 1 128 | 61,0 | 1 947 |
| 21,5 | 83 | 31,5 | 262 | 41,5 | 603 | 51,5 | 1 162 | 61,5 | 1 996 |
| 22,0 | 89 | 32,0 | 275 | 42,0 | 626 | 52,0 | 1 196 | 62,0 | 2 046 |
| 22,5 | 95 | 32,5 | 288 | 42,5 | 649 | 52,5 | 1 232 | 62,5 | 2 097 |
| 23,0 | 102 | 33,0 | 302 | 43,0 | 672 | 53,0 | 1 268 | 63,0 | 2 149 |
| 23,5 | 109 | 33,5 | 316 | 43,5 | 696 | 53,5 | 1 305 | 63,5 | 2 202 |
| 24,0 | 116 | 34,0 | 330 | 44,0 | 720 | 54,0 | 1 342 | 64,0 | 2 256 |
| 24,5 | 123 | 34,5 | 345 | 44,5 | 746 | 54,5 | 1 380 | 64,5 | 2 310 |
| 25,0 | 131 | 35,0 | 361 | 45,0 | 771 | 55,0 | 1 419 | 65,0 | 2 365 |
| 25,5 | 139 | 35,5 | 376 | 45,5 | 798 | 55,5 | 1 459 | 65,5 | 2 422 |
| 26,0 | 147 | 36,0 | 393 | 46,0 | 824 | 56,0 | 1 499 | 66,0 | 2 479 |
| 26,5 | 156 | 36,5 | 409 | 46,5 | 852 | 56,5 | 1 541 | 66,5 | 2 537 |
| 27,0 | 165 | 37,0 | 427 | 47,0 | 880 | 57,0 | 1 583 | 67,0 | 2 596 |
| 27,5 | 174 | 37,5 | 444 | 47,5 | 909 | 57,5 | 1 625 | 67,5 | 2 656 |
| 28,0 | 184 | 38,0 | 462 | 48,0 | 938 | 58,0 | 1 669 | 68,0 | 2 717 |
| 28,5 | 194 | 38,5 | 481 | 48,5 | 968 | 58,5 | 1 713 | 68,5 | 2 779 |
| 29,0 | 205 | 39,0 | 500 | 49,0 | 999 | 59,0 | 1 758 | 69,0 | 2 842 |
| 29,5 | 215 | 39,5 | 520 | 49,5 | 1 030 | 59,5 | 1 804 | 69,5 | 2 906 |

9.5 Determination of chemical resistance

9.5.1 Apparatus

9.5.1.1 Mould shall be a right cylinder (25 ± 1) mm in diameter by (25 ± 1) mm high. The mould shall be constructed in any manner that allows the formation of the desired test specimen.

Typical moulds consist of a (25 ± 1) mm thick flat plastic board in which (25 ± 1) mm diameter holes have been cut, and to the bottom of which a flat and smooth plastic sheet, at least 6 mm thick, without holes, which is attached by means of screws or any other suitable system. Alternatively, the moulds shall consist of sections of round plastic tubing or pipe, (25 ± 1) mm in inside diameter, and (25 ± 1) mm long, with sufficient wall thickness to be rigid and retain dimensional stability during the moulding operation, and a 6 mm thick flat plastic sheet on which one open end of each section shall be able to be rested.

NOTE The material from which the mould is constructed is chemically inert and has antistick properties. Polyethylene, polypropylene, polytetrafluoroethylene and metal forms having a sintered coating of tetrafluoroethylene polymer have been found satisfactory.

9.5.1.2 Containers

- a) Wide mouth jars of sufficient capacity, fitted with plastic or plastic-lined metal screw caps for low temperatures tests involving media of low volatility.
- b) Erlenmeyer flasks, of sufficient capacity, fitted with standard-taper-joints and a reflux condenser attachment for use with volatile media.
- c) Containers, as described in a) and b), of a suitable inert material for use with media which attack glass.

9.5.1.3 Compression machine, a test machine with suitable capacity and sensitivity for the test and with a variable testing speed. The machine shall be capable of applying the compression load to the specimen through a suitable compression jig designed to provide self-alignment with specimen.

9.5.1.4 Chemical agent shall consist of the media to which the chemical resistant materials are to be exposed in service.

9.5.2 Test specimen

9.5.2.1 Number

The number of specimens required is dependent upon the number of test media to be employed, the number of different temperatures at which testing is performed and the frequency of test intervals. In any case, the test specimen shall consist of sets of a minimum of three cylinders for one medium, at a single temperature and for each test interval. In addition, one set of at least three specimens shall be available for test immediately following the conditioning period, and other sets of at least three, equivalent to the number of test temperatures, for the total test period. Calculate the total number of specimens required as follows:

$$N = n(M \cdot T \cdot I) + n \cdot T + n$$

(5)

where

| | |
|----------|---|
| <i>N</i> | is the number of specimens; |
| <i>n</i> | is the number of specimens for a single test; |
| <i>M</i> | is the number of media; |
| <i>T</i> | is the number of test temperatures; |
| <i>I</i> | is the number of test intervals. |

9.5.2.2 Dimension

The test units shall be cast right cylinders, (25 ± 1) mm in diameter by (25 ± 1) mm high, with flat smooth faces normal to the axis of the cylinder, prepared in moulds described in [9.5.1.1](#) and employing no release agent in the mould.

9.5.2.3 Preparation

Mix the components in the ratio specified by the manufacturer's instructions. Blend the parts using a suitable hand tool or machine mixer, ensuring that any ingredients are thoroughly and uniformly mixed.

Place the product in the mould with a spatula, taking care to ensure complete filling of the mould cavity without entrapment of air. Scrape off the excess material with a flat trowel, making the exposed surface as smooth and even as possible. Permit the material to remain in the mould until it has set sufficiently to allow removal without danger of deformation or breakage.

9.5.2.4 Conditioning

Condition the test units for 7 d in standard conditions. After the 7 d, proceed as described in [9.5](#) on one set of specimens.

9.5.3 Test procedure

Immediately following the conditioning period measure the diameter of all test specimens to the nearest 0,03 mm using a micrometer. Make two measurements at right angles to each other and record the diameter as the average of the two.

Following the diameter measurement weigh all the specimen to the nearest 0,001 g on an analytical balance and record the values. Prior to immersion record a brief description of the colour and surface appearance of the specimen and of colour and transparency of the test medium.

Place the weighed specimen, to be immersed, on their curved sides into the container ([9.5.1.2](#)) taking care to prevent the cylinder faces coming in contact with each other. The total number of specimens per container is only limited by the ability of the container to hold the specimen plus the required amount of test medium per specimen.

Add (100 ± 5) ml of the chemical agent for each specimen and place the closed container in a constant-temperature oven adjusted to the required temperature or in a suitably adjusted liquid bath simulating the actual service and exposure as closely as possible. Replace agents that are known to be unstable, as often as necessary, in order to maintain the original chemical composition and concentration, for the planned intervals.

Remove the specimen after 28 d of immersion to determine the chemical attack. If necessary, employ other exposure periods.

Clean the specimen with three quick rinses in cold running tap water and quick dry by blotting with a paper towel between each rinse. After the final blotting allow the specimen to dry for 30 min, resting on its curved surface, weigh to the nearest 0,001 g and measure the diameter of the test specimen as described in [9.1](#).

Note any indication of surface attack on the specimen, any discoloration of the test specimen and the formation of any sediment.

Determine the compressive strength for one set of specimens:

- immediately after the conditioning period;
- after the exposure period for each chemical agent and each temperature;
- after ageing in air for the total test period at each test temperature.

The elapsed time between the removal of the specimen from the test medium and the compressive test should be uniform for all specimens. Place each specimen in the testing machine with the plane faces of the cylinder in contact with the surface of the compression tool or cage. Apply the load to the specimen at a crosshead movement of $(5,5 \pm 0,5)$ mm/min when the machine is running without load. Break the specimen and record the maximum load.

9.5.4 Evaluation and expression of results

9.5.4.1 Mass change

Calculate to the nearest 0,01 % the percentage loss or gain in mass of the specimen during exposure for each examination period as follows:

$$\Delta W = \left[(W - C) / C \right] \cdot 100 \quad (6)$$

where

- ΔW is the mass change, expressed in percentage;
 W is the mass of the specimen after immersion, in grams;
 C is the mass of the specimen after initial conditioning, in grams.

Determine the mean of the three values or more. A result showing a plus (+) sign shall indicate a gain in mass and a minus (-) sign shall indicate a loss.

9.5.4.2 Diameter change

Calculate to the nearest 0,01 % the percentage change of the diameter of the specimen during exposure for each examination period, taking the diameter after the 7 d conditioning as 100 %.

Change in diameter is given by:

$$\Delta D = \left[(D_2 - D_1) / D_1 \right] \cdot 100 \quad (7)$$

where

- ΔD is the diameter change, expressed in percentage;
 D_2 is the diameter of the specimen after the exposure period, in millimetres;
 D_1 is the diameter of the specimen after the initial conditioning, in millimetres.

Determine the mean of three values or more. A result showing a plus (+) sign shall indicate a gain in diameter and a minus (-) sign shall indicate a loss.

9.5.4.3 Change of compressive strength value

Calculate to the nearest 0,01 % the percentage decrease or increase of compressive strength of the specimen during exposure for each examination period, taking the compressive strength after the 7 d conditioning period in standard conditions as 100 %. Calculate the cross-sectional area of the specimen on the diameter value as determined in 9.1.

Change in compressive strength is given by:

$$\Delta S = \left[(S_2 - S_1) / S_1 \right] \cdot 100$$

(8)

where

ΔS is the change in compressive strength, in percentage;

S_1 is the load calculated per cross-sectional area of specimen after the conditioning period, in megapascals;

S_2 is the load calculated per cross-sectional area of specimen after the exposure period, in megapascals.

A result showing a plus (+) sign shall indicate a gain in compressive strength and a minus (-) sign shall indicate a loss.

9.5.5 Test report

The test report shall provide the following information:

- a) number, title and issue of this document;
- b) place, date and time of sampling;
- c) type of grout or adhesive, commercial designation and manufacturer name;
- d) identification of test sample;
- e) handling and storage of samples before testing;
- f) exposure conditions to the chemical agent, frequency of change of chemical agent, temperature, etc.;
- g) date of test;
- h) colour and surface appearance of test units before testing;
- i) total duration of the test and the exposure periods, in days. For each exposure period the following data are required:
 - average percentage of diameter change of specimen;
 - average percentage of mass change of specimen;
 - appearance of specimen after immersion (surface cracks, loss of gloss, etching, pitting, softening, etc.);
 - appearance of the test chemical agent (discoloration, sediment, etc.);
 - average percent change in the compressive strength of specimen;
- j) any other factor which could have influenced the result.

Bibliography

- [1] [EN 197-1](#), *Cement - Part 1: Composition, specifications and conformity criteria for common cements*
- [2] [EN 459-2](#), *Building lime - Part 2: Test methods*
- [3] [EN 12004-1](#), *Adhesives for ceramic tiles - Part 1: Requirements, assessment and verification of constancy of performance, classification and marking*
- [4] [EN 14411](#), *Ceramic tiles - Definition, classification, characteristics, assessment and verification of constancy of performance and marking*

<http://www.china-gauges.com/>

<http://www.china-gauges.com/>

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Copyright in BSI publications

All the content in BSI publications, including British Standards, is the property of and copyrighted by BSI or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use.

Save for the provisions below, you may not transfer, share or disseminate any portion of the standard to any other person. You may not adapt, distribute, commercially exploit or publicly display the standard or any portion thereof in any manner whatsoever without BSI's prior written consent.

Storing and using standards

Standards purchased in soft copy format:

- A British Standard purchased in soft copy format is licensed to a sole named user for personal or internal company use only.
- The standard may be stored on more than one device provided that it is accessible by the sole named user only and that only one copy is accessed at any one time.
- A single paper copy may be printed for personal or internal company use only.

Standards purchased in hard copy format:

- A British Standard purchased in hard copy format is for personal or internal company use only.
- It may not be further reproduced – in any format – to create an additional copy. This includes scanning of the document.

If you need more than one copy of the document, or if you wish to share the document on an internal network, you can save money by choosing a subscription product (see 'Subscriptions').

Reproducing extracts

For permission to reproduce content from BSI publications contact the BSI Copyright and Licensing team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email cservices@bsigroup.com.

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Useful Contacts

Customer Services

Tel: +44 345 086 9001

Email: cservices@bsigroup.com

Subscriptions

Tel: +44 345 086 9001

Email: subscriptions@bsigroup.com

Knowledge Centre

Tel: +44 20 8996 7004

Email: knowledgecentre@bsigroup.com

Copyright & Licensing

Tel: +44 20 8996 7070

Email: copyright@bsigroup.com

BSI Group Headquarters

389 Chiswick High Road London W4 4AL UK